

This document must be retained for future reference.

It is the responsibility of the person installing the electrical equipment to ensure that the installation meets the requirements of the IET wiring regulations and is therefore 'fit for purpose'. Factors such as correct selection of components, cable sizing, protective devices and Earth bonding are all critical and should be checked prior to full testing and power-up. Any other regulations applicable to the equipment being installed such as the Machinery Directive and current health and safety legislation must also be adhered to.

All connections (including factory made) must be checked for the correct tightness prior to commissioning of the electrical installation.
All connections should also be inspected periodically to ensure correct tightness.


DO NOT USE POWER TOOLS ON THESE PRODUCTS



ISP3163F + ISP3163P
IP44 Three Outlet Splitter



Dimensions

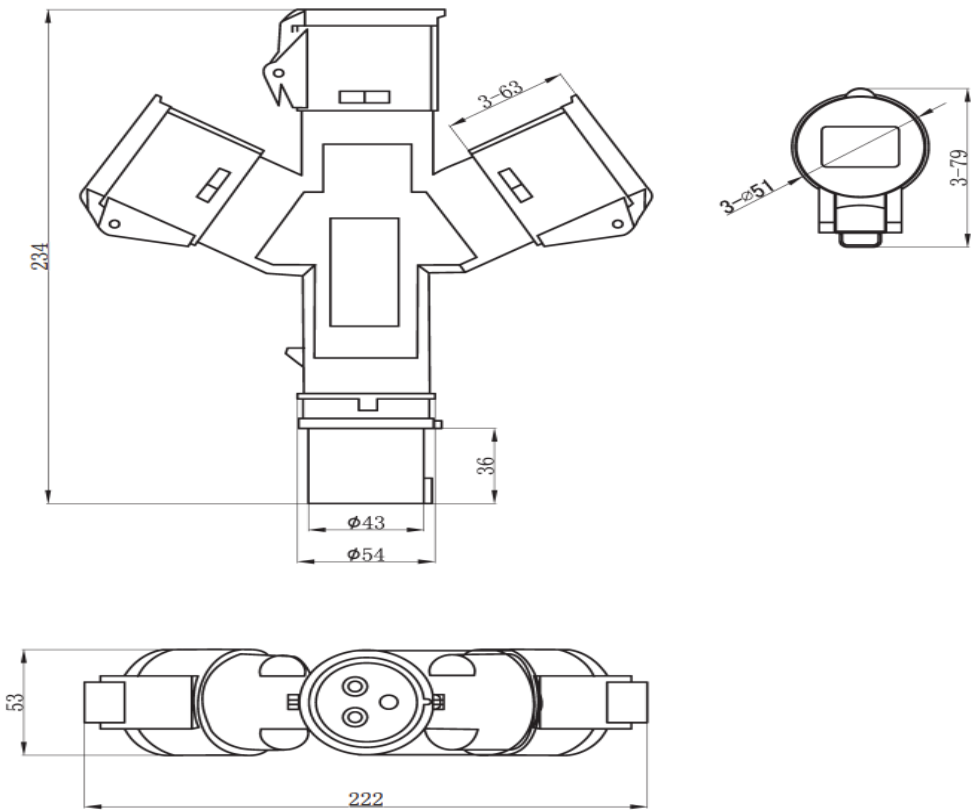

Part Number	Amperage	Voltage	Number of Poles	Approvals
ISP3163F	16A	110V - 130V	2P + E	IEC309 - 2 / CE
ISP2163P	16A	220V - 250V	2P + E	IEC309 - 2 / CE